




EXHAUST GAS HEAT EXCHANGER  
MARK WALKER  
14 March 2008

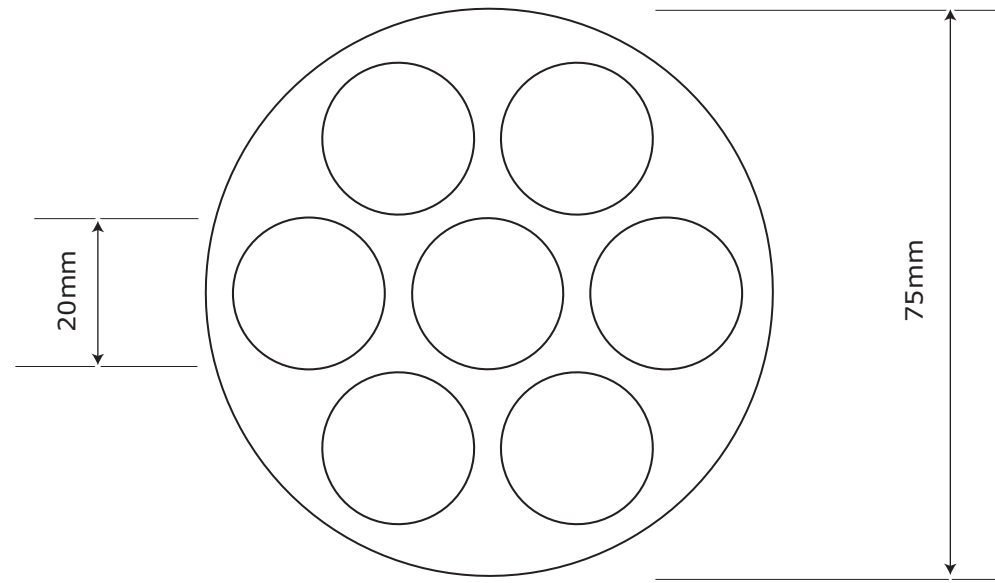

To scale 1:1

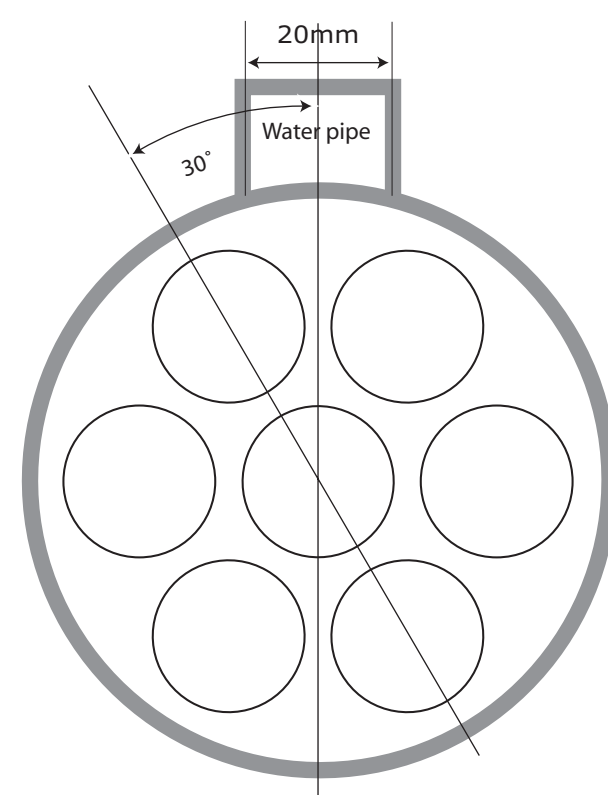

Water pipe position relative to air pipes

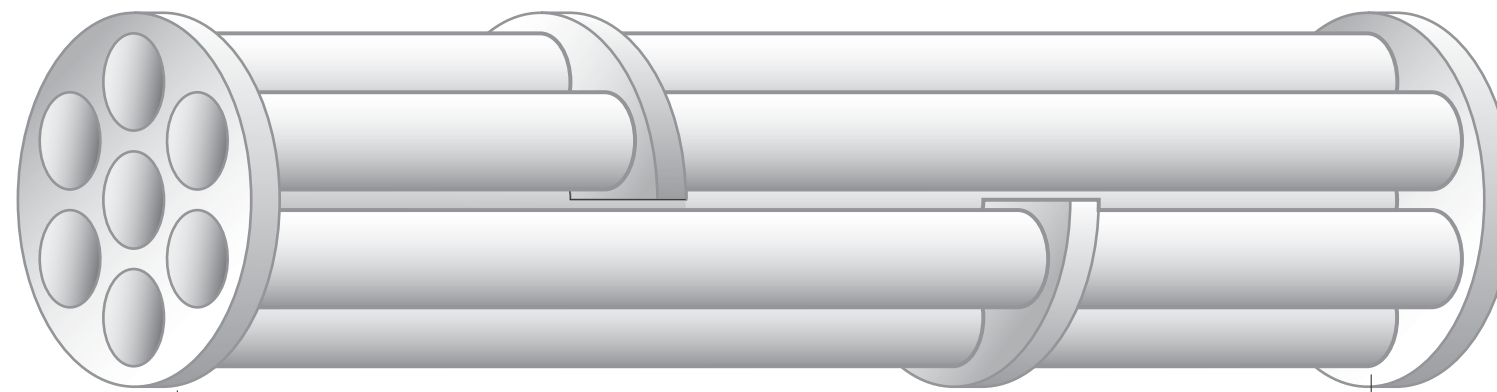


Water pipe entry immediately adjacent to flange

Not to scale

Water pipe entry immediately adjacent to flange

1200mm

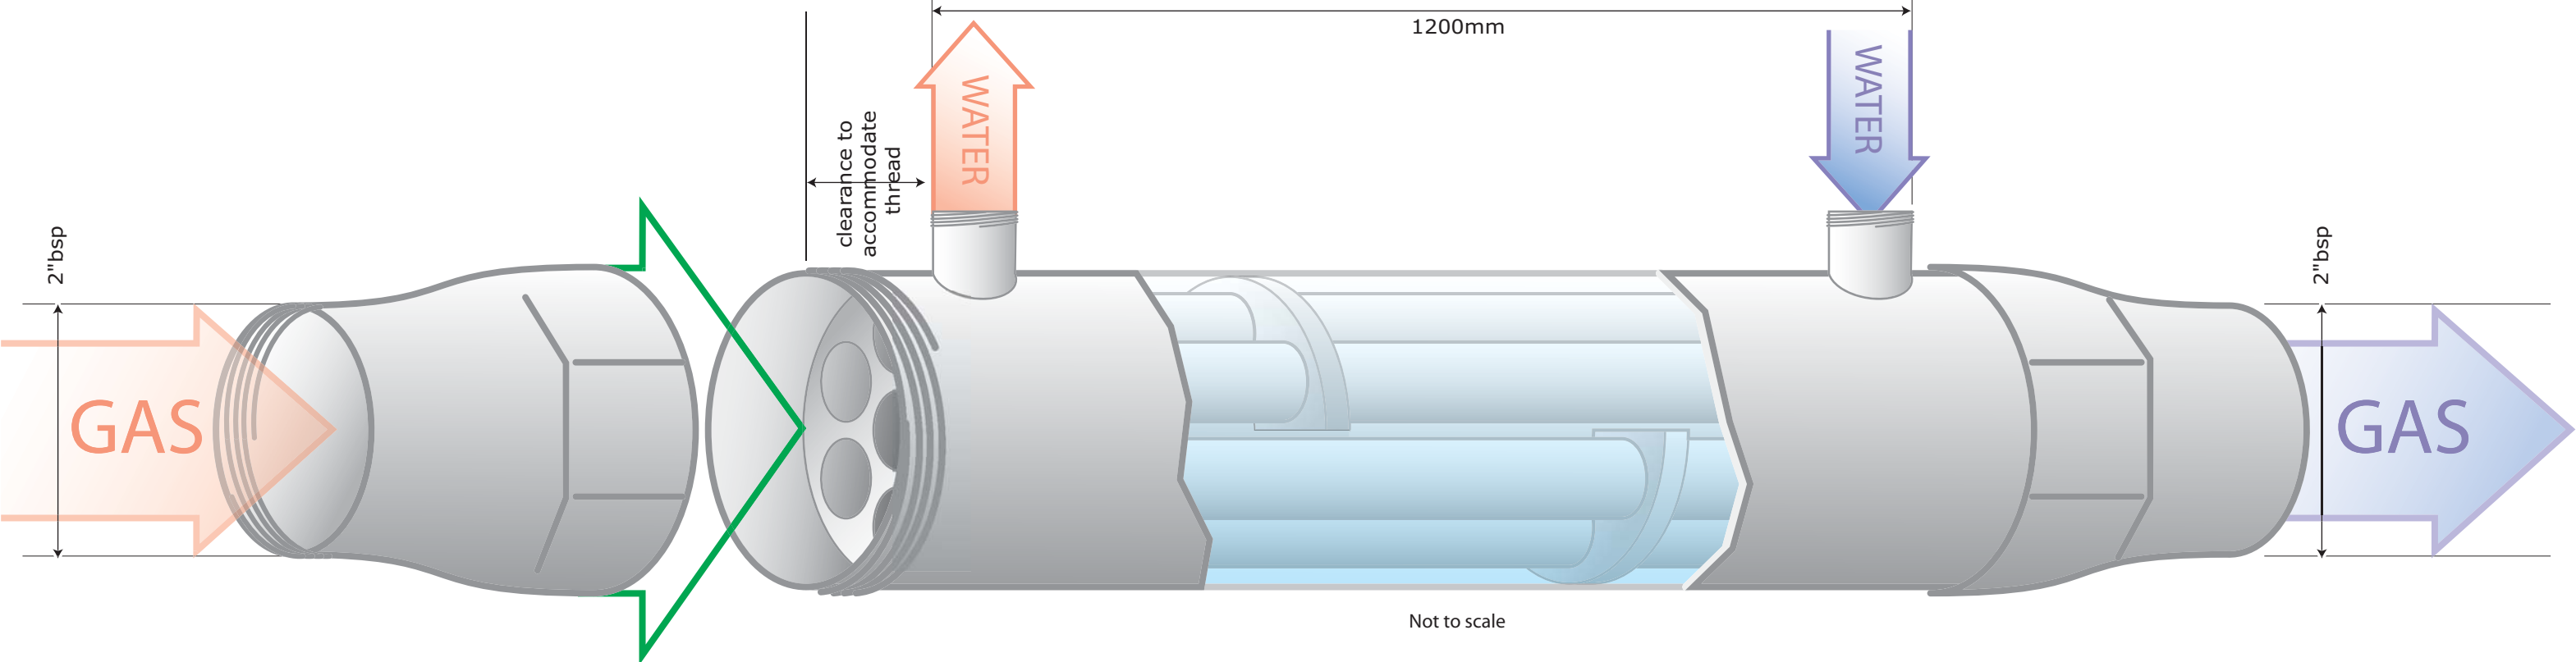

Not to scale